




STANDARD LAYOUT

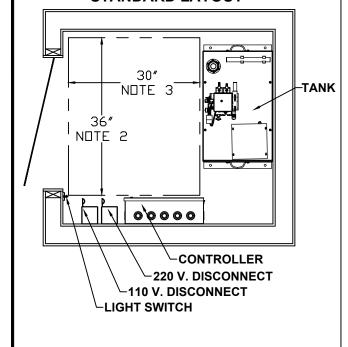


CONTROLLER MOUNTED ABOVE AND FLUSH WITH FRONT OF PUMP

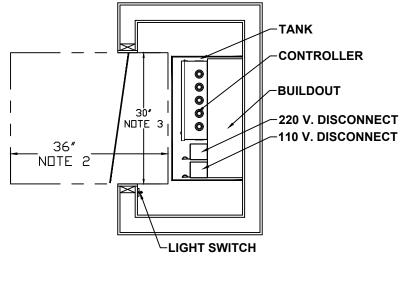



TANK



NOTES:

- 1. LOCAL, STATE, & NATIONAL CODES MUST ALWAYS BE FOLLOWED.
- 2. 36" MINIMUM CLEARANCE IN FRONT OF CONTROLLER PANEL REQUIRED PER N.E.C.
- 3. 30" MINIMUM WIDTH OR THE WIDTH OF THE EQUIPMENT REQUIRED PER N.E.C.
- 4. THE HEIGHT OF THE WORKING SPACE IN FRONT OF THE EQUIPMENT MUST NOT BE LESS THAN 78" MEASURED FROM HE GRADE, FLOOR, PLATFORM, OR THE EQUIPMENT HEIGHT, WHICHEVER IS GREATER.
- 5. A LOCKABLE SERVICE DISCONNECT MUST BE PLACED WITHIN SIGHT OF THE CONTROLLER AND MUST BE EASILY ACCESSIBLE IN CASE OF AN EMERGENCY.
- 6. MACHINE ROOM MUST CONTAIN A CONVENIENCE OUTLET AND LIGHT WITH SWITCH.
- 7. TEMPERATURE IN HOISTWAY AND MACHINE ROOM TO BE MAINTAINED BETWEEN 60-110° F AND RELATIVE HUMIDITY SHOULD NOT EXCEED 95%.
- 8. TANK REQUIRES OIL TYPE AW-32, AMOUNT 20 GAL.



ELEVATOR CONTRACTOR:

JOB NAME:

ORDER NUMBER:

HYDRAULIC ELEVATOR
TYPICAL MACHINE ROOM LAYOUT

DRAWN BY:

DATE:

SIGNATURE OF APPROVAL

DWG. NO.

C-003021